LED Parking Garage Light Installation Instruction

Cautions:

1. Can not use the electric generator to test the LED lamp.

- 2. Please abide by related country, regional and local law and regulations when install this fixture.
- 3. Please turn off the power before installation or maintenance.
- 4. Proper earth grounding is required to ensure safety.


Notice:

- 1. To avoid possibility of electrical shock or fire, the installation personnel must have professional electric knowledge.
- 2. Please wear gloves to avoid injury before installation.
- 3. If any smoke or spark of the wire happened, please turn off the power immediately and notify relevant personnel.

Attention:

- 1. Please check if there is any damage during shipping. If so, please contact manufacturer timely.
- 2. Please read the installation instruction carefully to check whether all the accessories are complete. After confirmation, then install the fixture according to installation steps.

Wiring Diagram:

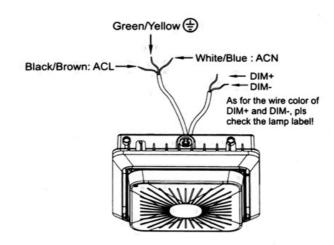

☑Installation Method I:

- 1. Disassemble the driver box cover by loosen the two screws on the driver box; Figure 1-1
- 2. Loosen the 3/4 plug on the driver box cover by screwdriver; Figure 1-2
- 3. Fix the driver box cover on the 3/4 tube; Figure 1-3
- 4. Insert the mounting hole of radiator horizontally to the shaft of driver cover; Figure 1-4
- 5. Connect the input line and ground; If the fixture is equipped with sensor, adjust the sensor settings, Take relevant waterproof measures after the wires are connected; Figure 1-5
- 6. Turn the radiator up then cover the driver box, Figure 1-6
- 7. Lock the two cap screws, the product is installed. Figure 1-7




Figure 1-1



Figure 1-2



Figure 1-3

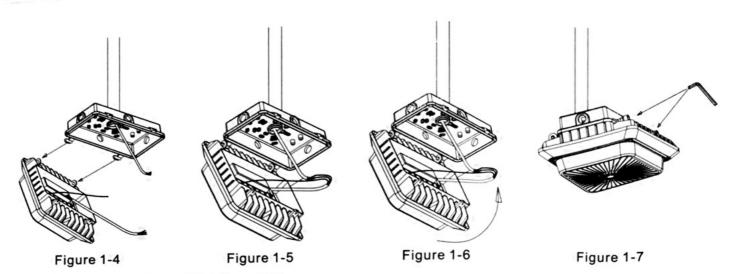


☑Installation Method II :


- 1. Disassemble the driver box cover by loosen the two screws on the driver box; Figure 2-1
- 2. Loosen the 3/4 plug on the driver box cover by screwdriver; Figure 2-2
- 3. Drill the holes on the ceiling accordingly to fit the plate; Figure 2-3
- 4. Fix the driver box cover on the ceiling; Figure 2-4
- 5. Insert the mounting hole of radiator horizontally on the shaft of driver cover; Figure 2-5
- 6. Connect the input line and ground; If the fixture is equipped with sensor, adjust the sensor settings; Take relevant waterproof measures after the wires are connected; Figure 2-6
- 7. Turn the radiator up then cover the driver box, Figure 2-7
- 8. Lock the two cap screws, the product is installed. Figure 2-8 Ø121mm Ø89mm Ø78.1mm ø70mm Ø52.6mm Ø52.3mm Figure 2-4 Figure 2-3 Figure 2-2 Figure 2-1 Figure 2-8 Figure 2-5 Figure 2-6 Figure 2-7

□Installation Method III :

- 1. Disassemble the driver box cover by loosen the two screws on the driver box; Figure 3-1
- 2. Loosen the 3/4 plug on the driver box cover by screwdriver; Figure 3-2
- 3. Drill holes on the ceiling; Figure 3-3
- 4. Fix the driver box cover on the ceiling; Figure 3-4
- 5. Fix the lower bracket on the driver box cover; Figure 3-5
- 6. Align with the holes of upper and lower bracket; tighten with screws; Figure 3-6
- 7. Insert the mounting hole of radiator horizontally on the shaft of driver cover; Figure 3-7
- 8. Use M20 waterproof connector when connecting AC wire or dimming wire, take relevant waterproof measures at both sides of inlet. Figure 3-8
- 9. Connect the input line and ground; If the fixture is equipped with sensor, adjust the sensor settings; Take relevant waterproof measures after the wires are connected ; Figure 3-9
- 10. Turn the radiator up then cover the driver box, Figure 3-10
- 11. Lock the two cap screws, the product is installed. Figure 3-11

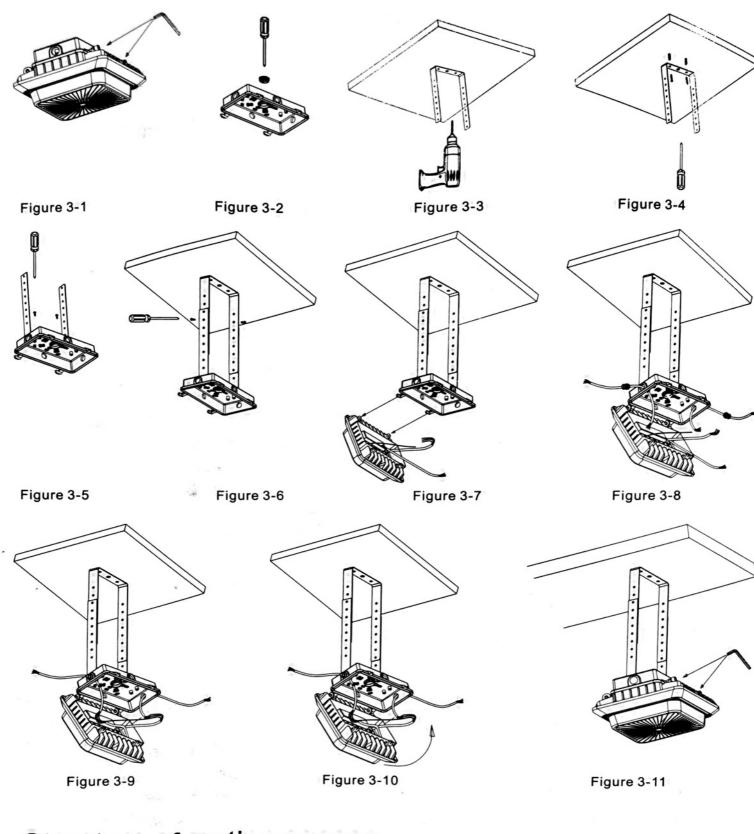

Structure of motion sensor

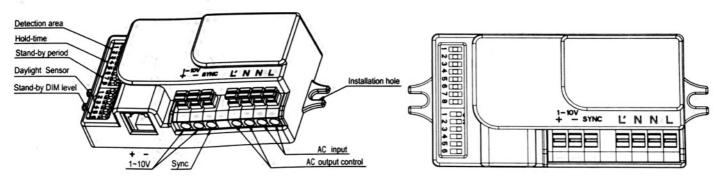

Setting:

By selecting the combination on the DIP switch, sensor data can be precisely set for each specific application.

| ON T | | 1 | 2 | |
|------|-----|-----|----|------|
| | I | ON | ON | 100% |
| | II | ON | - | 75% |
| 7 | III | - , | ON | 50% |
| | IV | - | - | 25% |

| | | | | | 2 | |
|----|-----|-----|----|---|----------|------|
| | I | 0 | ON | | N | 100% |
| ON | II | ON | | | | 75% |
| 2 | III | - | 1. | | N | 50% |
| | IV | | | | - | 25% |
| | П | 3 | 4 | 1 | 5 | |
| | - | ONI | _ | | O | - 50 |

| | | 3 | 4 | 5 | 7 |
|---------|-----|----|-----|----|-------|
| o× ■ | I | ON | ON | ON | 58 |
| | II | - | ON | ON | 30S |
| | III | ON | ı | ON | 908 |
| | ΙV | - | - | ON | 3min |
| | V | ON | ON | - | 20min |
| | VI | Ξ | 1 - | - | +8 |

| ON • | | 6 | 7. | 8 | |
|---------|-----|------|----|-----|-------|
| | I | ON | ON | ON | 08 |
| | II | i,—, | ON | ON | 58 |
| | III | ON | - | ON | 5min |
| | IV | - | - | ON | 10min |
| | V | ON | ON | -1 | 30min |
| | VI | - | ON | - 1 | - 1h |
| | VII | - , | | - | +∞ |

| ON † | | 1 | 2 | 1 |
|---------|-----|-----|----|-----|
| | Ι | ON | ON | 50% |
| | II | - | ON | 30% |
| | III | ON | - | 20% |
| | IV | - , | - | 10% |

| ON ■ | - 0 | 3 | 4 | 5 | 6 | 1 |
|---------|-----|----|-----|----|-------------------------------|---------|
| | I | ON | | ON | ON | 5Lux |
| | II | 1- | ON | ON | ON | 15Lux |
| | III | ON | - | ON | ON | 30Lux |
| | IV | - | 1 | ON | 8 | 50Lux |
| | V | ON | ON | ı | ON | 100Lux |
| | VI | ON | ON | ON | - | 150Lux |
| | VII | - | 1-1 | | $\hat{p}_{ij} = \hat{p}_{ij}$ | Disable |

Detection area

Detection area can be reduced by selecting the combination on the DIP switches to fit precisely each application.

Factory setting: I

Hold time

Refers to the time period the lamp remains at 100% illumination after no motion detected.

Factory setting: VI

Stand-by period

Refers to the time period the lamp remains at a low light level before it completely switches off in the long absence of people. When set to Disable mode, the low light is maintained until motion is detected.

Factory setting: I

Stand-by dimming level

The low light level you would like to have after the hold time in the long absence of people.

Factory setting: I

Daylight sensor

The sensor can be set to only allow the lamp to illuminate below a defined ambient brightness threshold.

When set to Disable mode, the daylight sensor will switch on the lamp when motion is detected regardless of ambient light level.

100lux, 100lux, 50lux: twilight operation, 10lux, 5lux: darkness operation only. Note that daylight sensor is active only when lamp totally switches off.

Factory setting: VII

Warning / Avertissement

MIN 75°C SUPPLY CONDUCTOR

THIS PRODUCT MUST BE INSTALLED IN ACCORDANCE WITH THE APPLICABLE INSTALLATION CODE BY A PERSON FAMILIAR WITH THE CONSTRUCTION AND OPERATION OF THE PRODUCT AND THE HAZARDS INVOLVED.

LES FILS D'ALIMENTATION 75°C MIN

CE PRODUIT DOIT ÊTRE INSTALLÉ SELON LE CODE D'INSTALLATION PERTINENT, PAR UNE PERSONNE QUI CONNAÎT BIEN LE PRODUIT ET SON FONCTIONNEMENT AINSI QUE LES RISQUES INHÉRENTS.